



MASTERTEMP®

INSTALLATION INSTRUCTIONS



WARNING FAILURE TO FOLLOW ALL INSTRUCTIONS AND WARNINGS CAN RESULT IN SERIOUS BODILY INJURY OR DEATH.


IP EI AAE A E IE
VA AIE P E IEP E I AAI AAE ,P
PE A A E EA EE A I A A
I I I E EAE I AAAI A E' E E E
I IP . EEI I EAE I E
P E .

a a at t t P ta A at t m m a t
at t a a a a . <http://www.pentairpool.com/safety-warnings>
a (00) 31-7133 a t a t t t .

For indoor heater installations where combustion air supply might be insufficient, the MasterTemp® and Max-E-Therm® heaters are certified for a direct air intake duct using 3-inch PVC pipe. If outside air is drawn through 3" PVC duct directly into the heater, PVC pipe can be installed in accordance with the following requirements:

The air intake opening MUST be installed at least 1 ft. above the roof line or normal snow levels for free air flow. The Category I or III exhaust vent termination cap must have at least 3 ft. minimum vertical clearance from air intake duct. *See diagram on next page.*

Air Intake Kit Contents

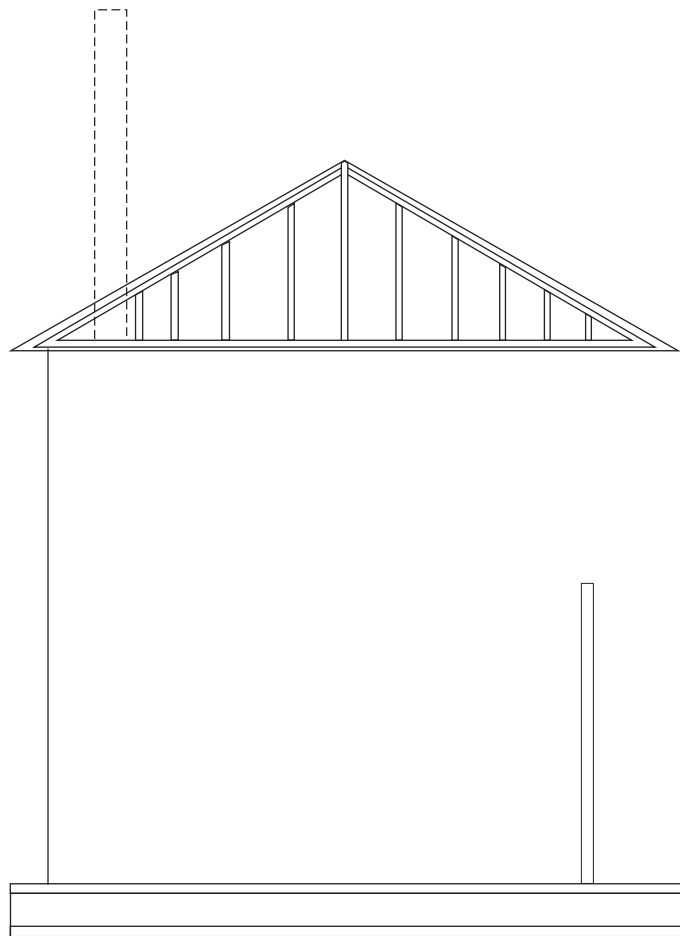

Flue Exhaust
Vent Cap

1. m t a nt at (.1).

5. Ata a t aat t tt a
tt ta (.5).

2. l a t a tt m t
(.2a .3).

6. l ta a a t t
t t a tt m (.6).

7. l ta a a t t P
t t t a (.7).

. l ta a a 3" P t
t at m t (.).

σ. Pa a t a t t t
at t t t t .



t



1620 HAWKINS AVE., SANFORD, NC 27330 ☎ (919) 566-8000
10951 WEST LOS ANGELES AVE., MOORPARK, CA 93021 ☎ (805) 553-5000

Technical Support: 800.831.7133

www.pentairpool.com

All Pentair trademarks and logos are owned by Pentair or one of its global affiliates. Pentair Aquatic Systems' and MasterTemp® are trademarks and/or registered trademarks of Pentair Water Pool and Spa, Inc. and/or its affiliated companies in the United States and/or other countries. Unless expressly noted, names and brands of third parties that may be used in this document are not used to indicate an affiliation or endorsement between the owners of these names and brands and Pentair Water Pool and Spa, Inc. Those names and brands may be the trademarks or registered trademarks of those third parties. Because we are continuously improving our products and services, Pentair reserves the right to change specifications without prior notice. Pentair is an equal opportunity employer.

474441

© 2014 Pentair Aquatic Systems. All rights reserved. This document is subject to change without notice.

P/N 474441 Rev C 5/2014