




AURORA ACCESSORIES

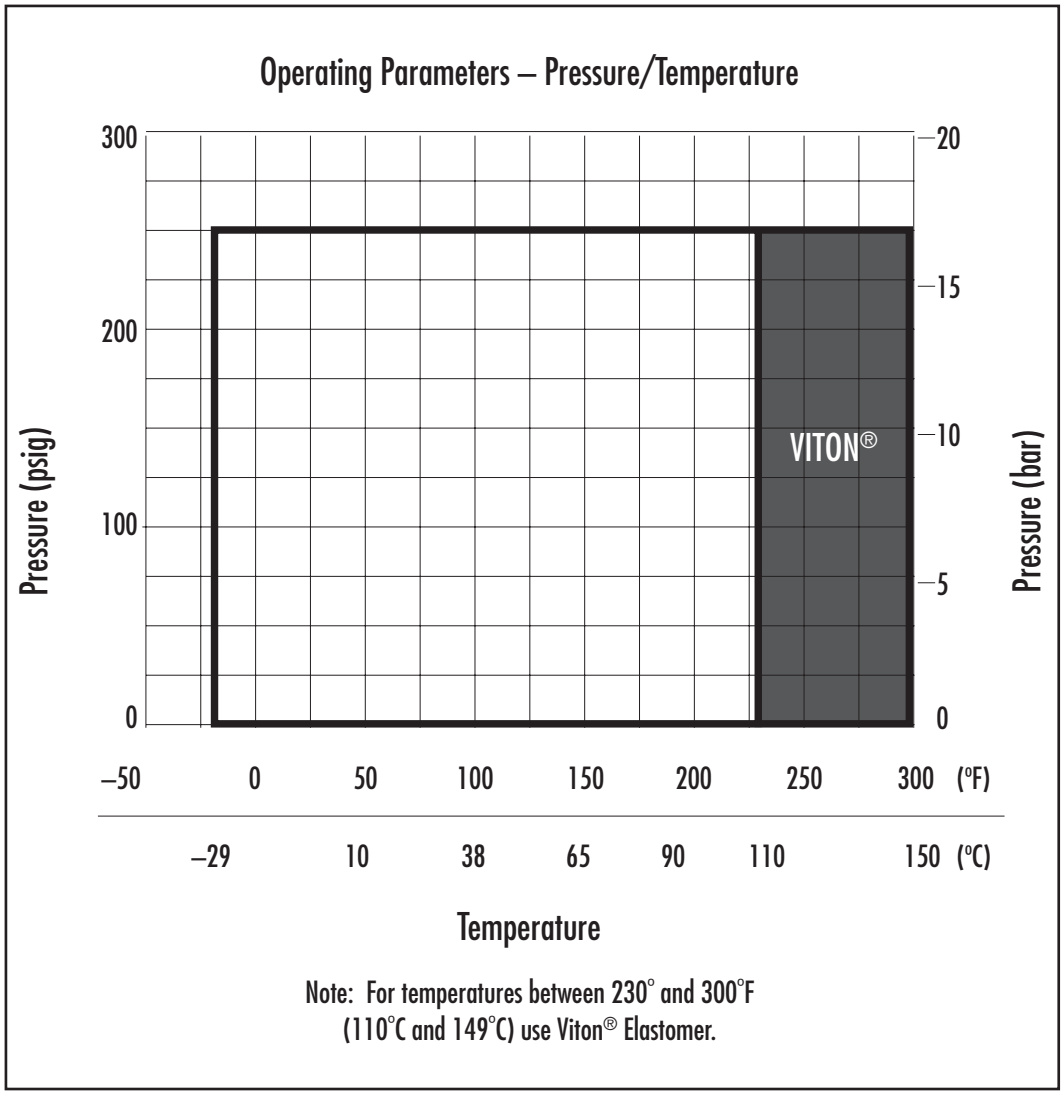

THIS PAGE INTENTIONALLY LEFT BLANK

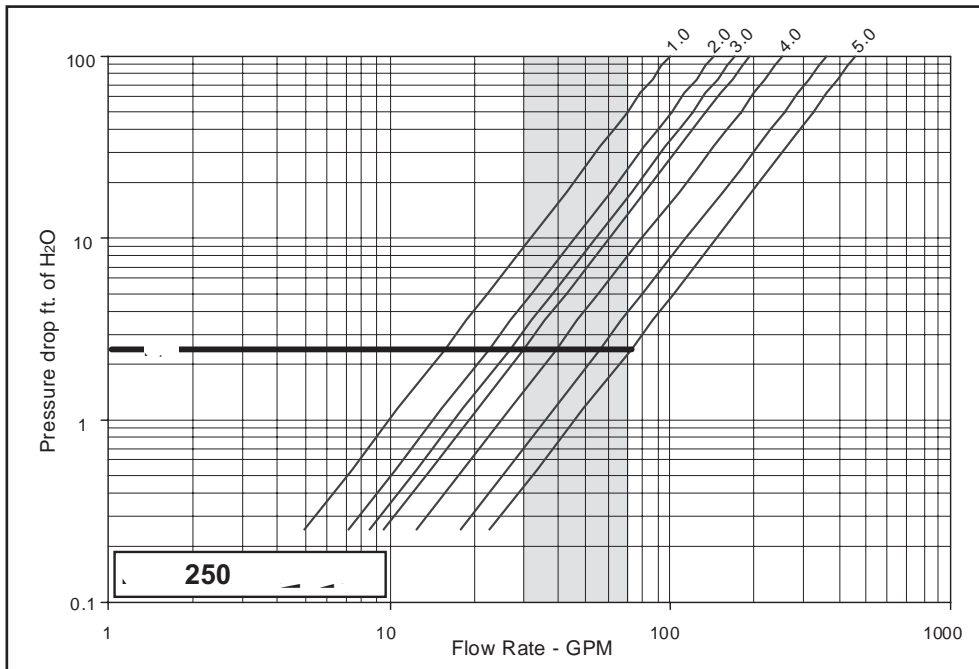

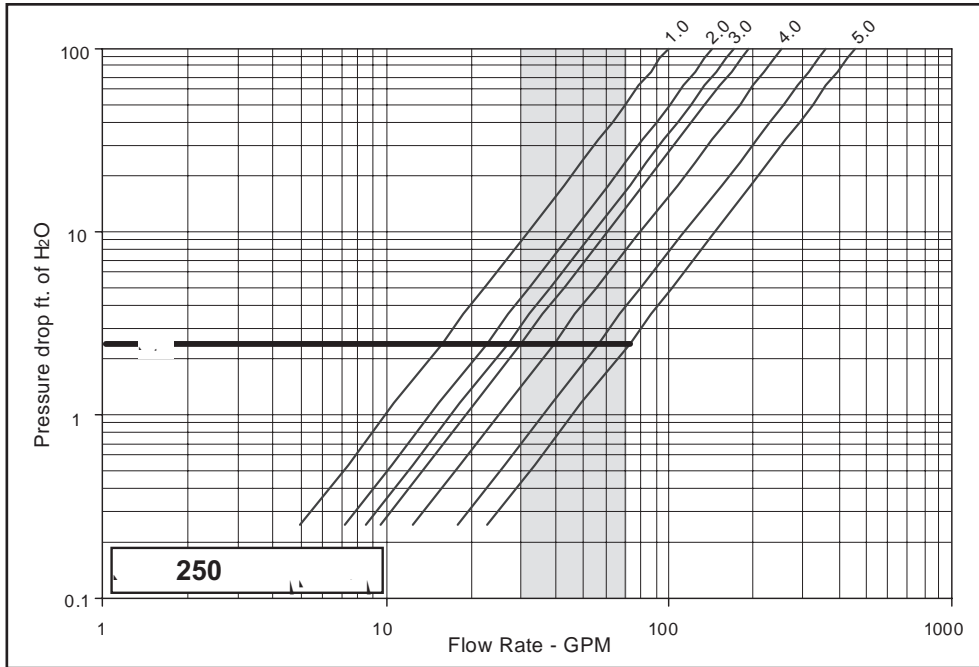


For head loss determination, valve selection, and valve pressure drop to flow correlation.

For reliable flow measurement with less than 3" (water gauge) of differential pressure across the valve, use a separate flowmeter or equivalent.

The shaded area is the flowrate range representing headless between 1 to 4 ft/100 ft for the nominal pipe size. Operating below 1 ft/100 ft may reduce system air extraction efficiency, and above 4 ft/100 ft may induce velocity related noise or erosion in system components.

AURORA ACCESSORIES


1/2" + 1/8" 0
1/2" + 1/8" + 1/8"

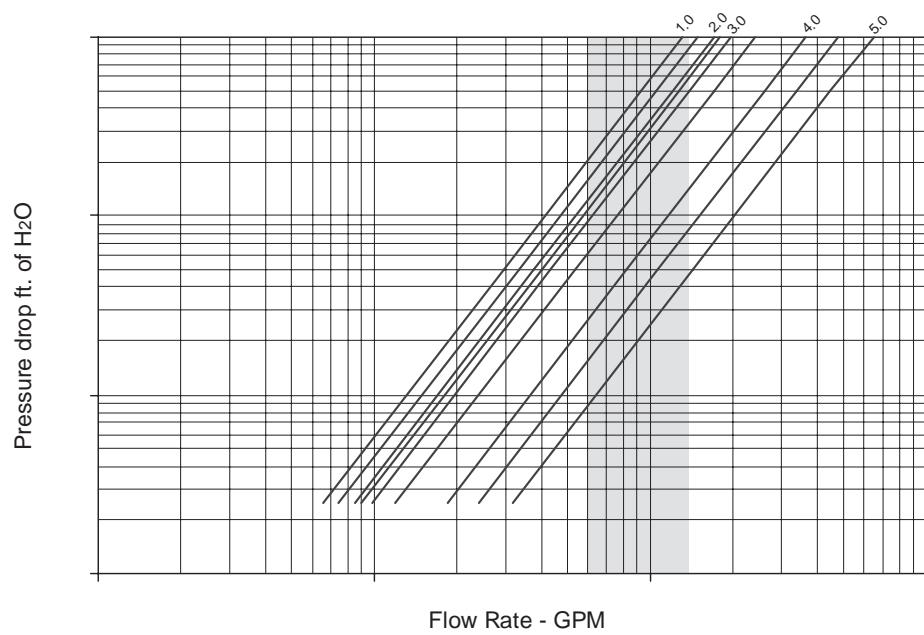

AURORA ACCESSORIES

1040 319


JUNE 2012

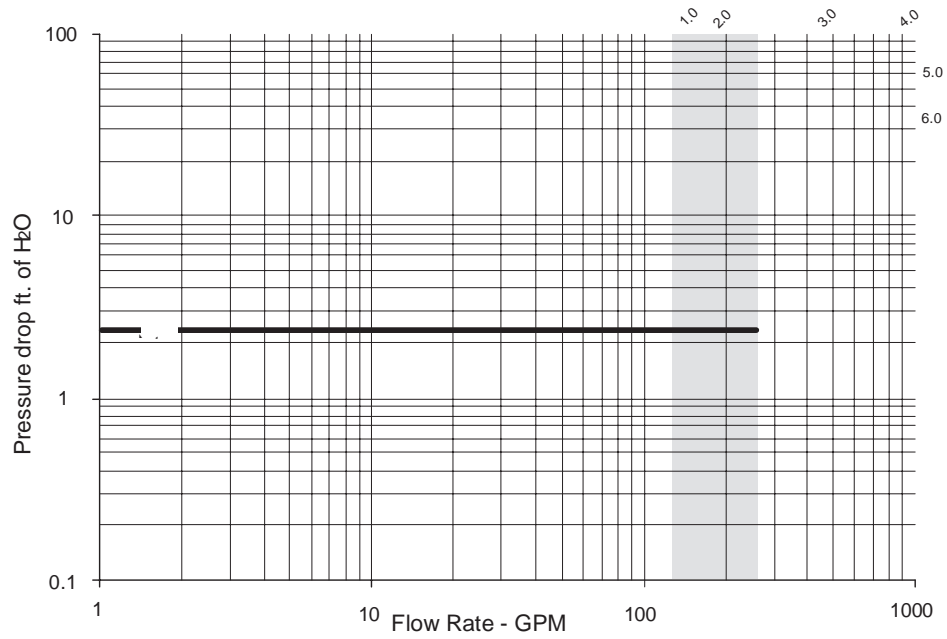



AURORA ACCESSORIES

1040 321

JUNE 2012

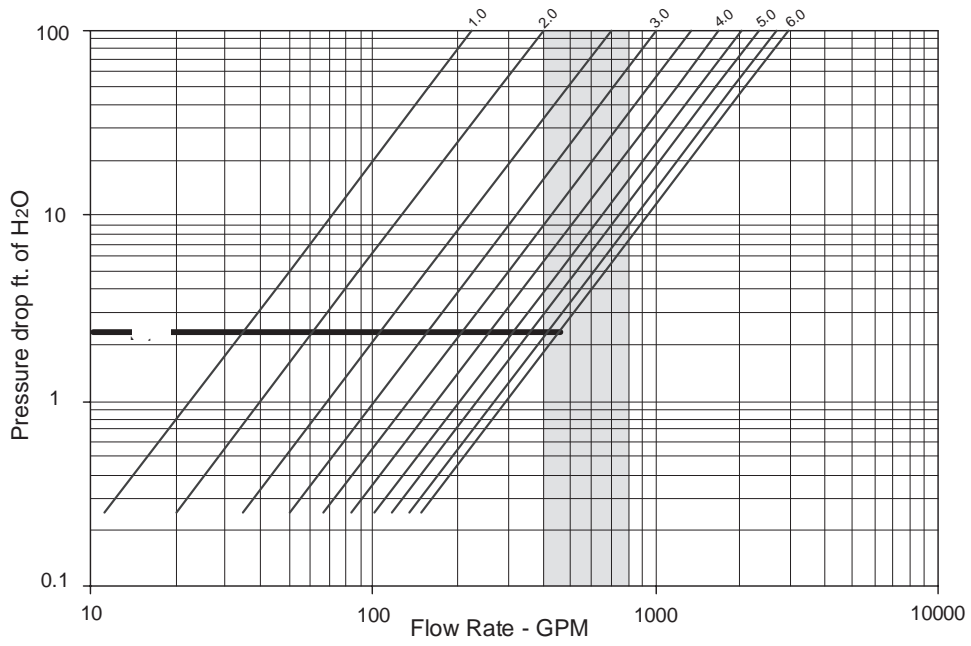



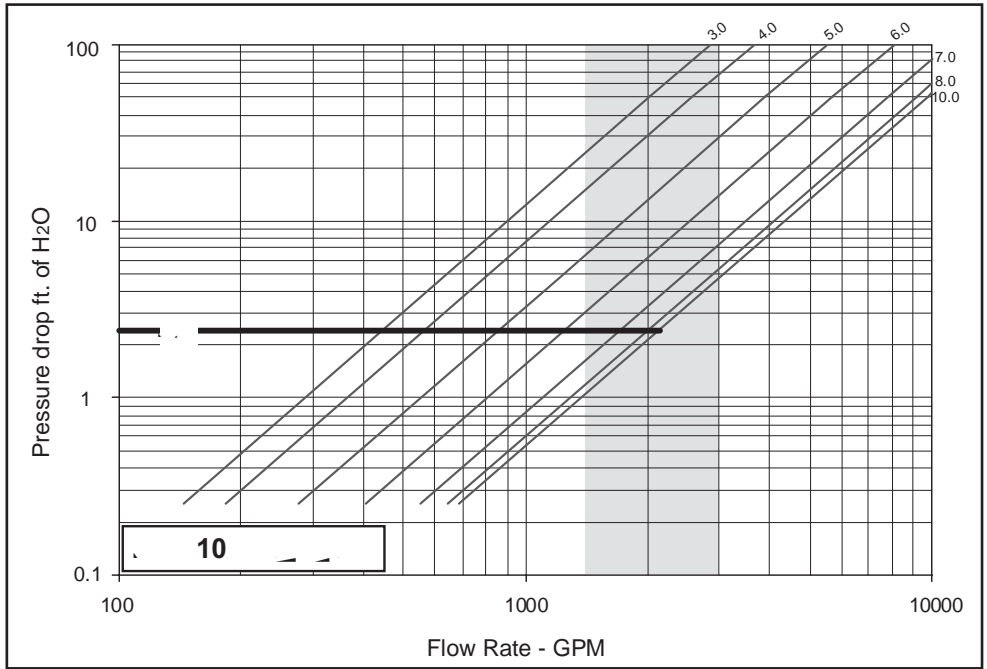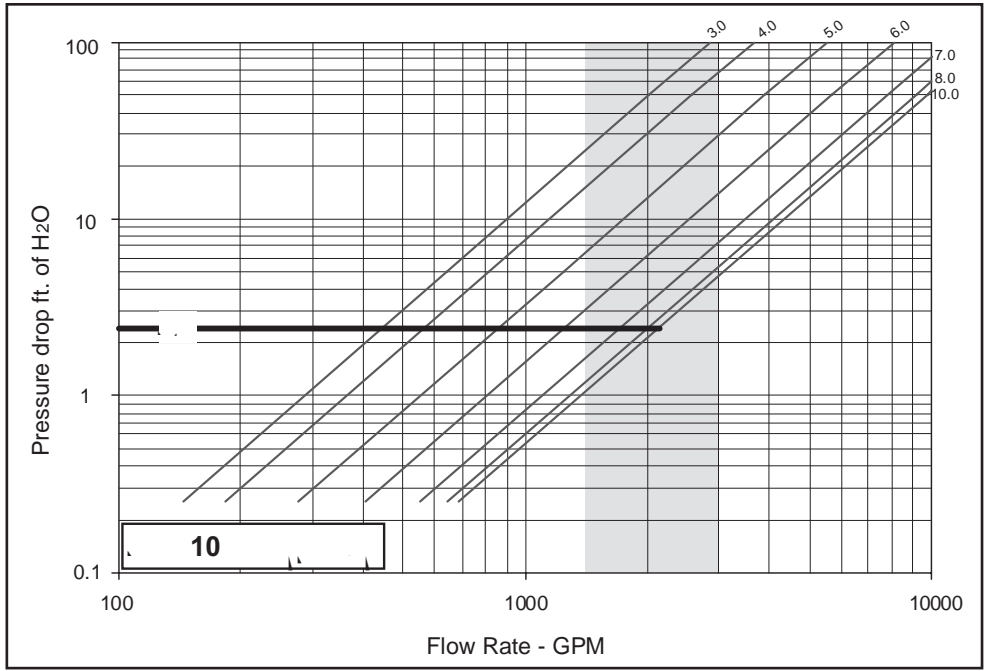


For head loss determination, valve selection, and valve pressure drop to flow correlation.


For reliable flow measurement with less than 3" (water gauge) of differential pressure across the valve, use a separate flowmeter or equivalent.

The shaded area is the flowrate range representing headless between 1 to 4 ft/100 ft for the nominal pipe size. Operating below 1 ft/100 ft may reduce system air extraction efficiency, and above 4 ft/100 ft may induce velocity related noise or erosion in system components.

AURORA ACCESSORIES

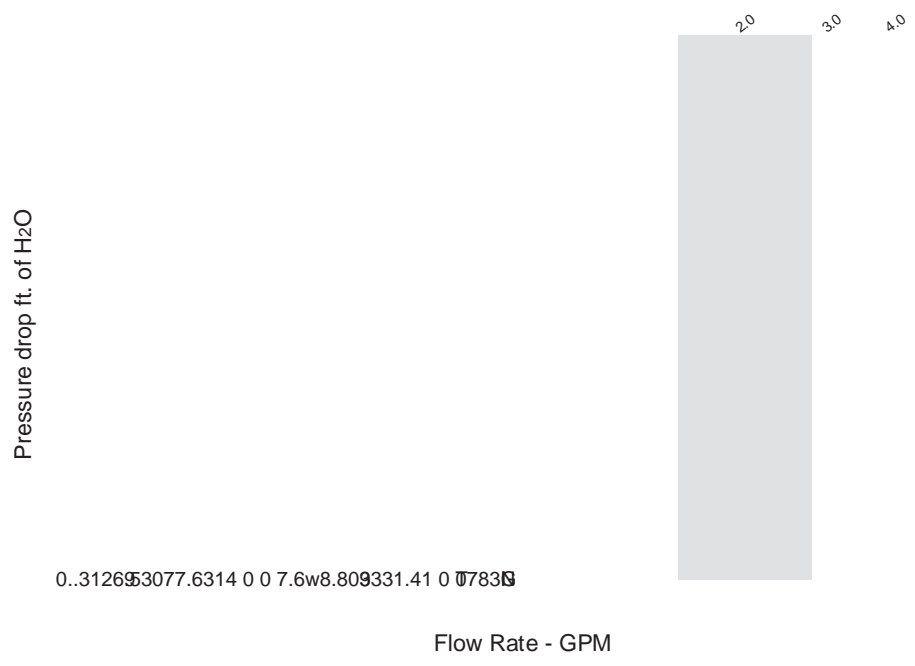

0..312653077.6314 0 0 7.6w8.809331.41 0 0783

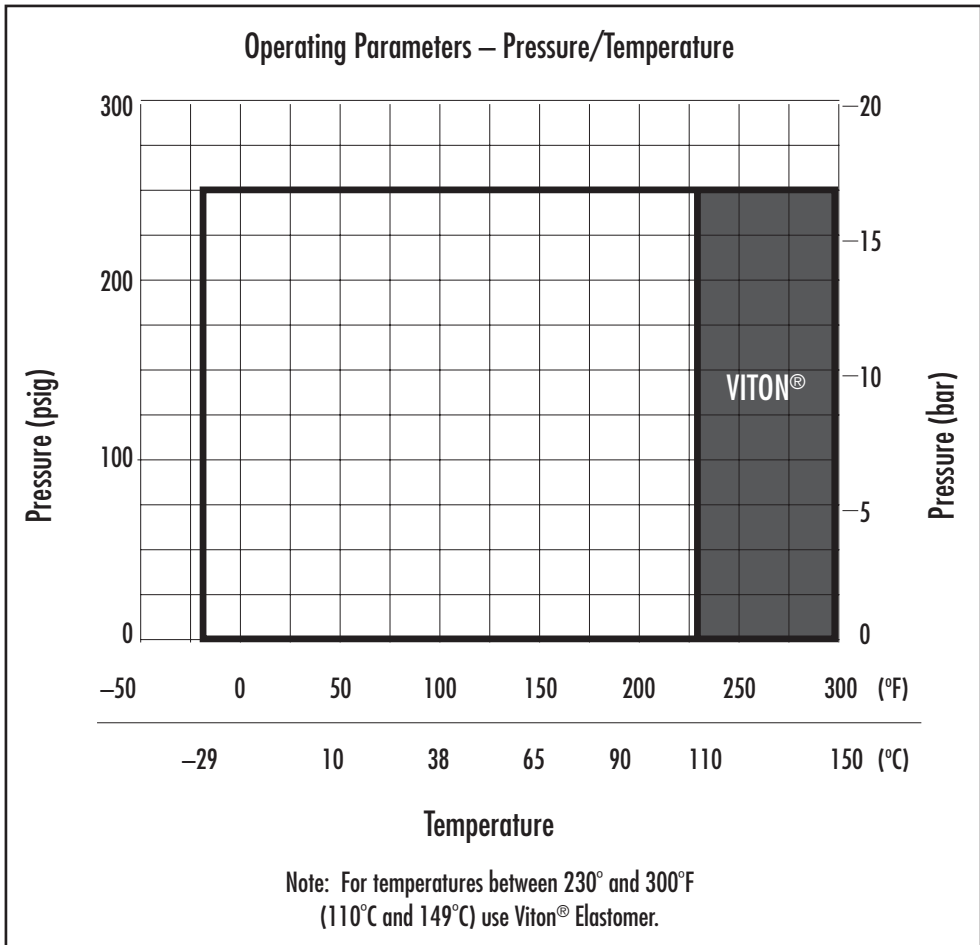

Pressure–Temperature Limits

